



VILLAGE OF PELHAM
WESTCHESTER COUNTY, NEW YORK

Street Opening Instructions

1. All work related to a street opening permit must be performed strictly in accordance with all applicable regulations of the Village of Pelham and to the satisfaction of the Village Administrator.
2. The permit shall not be assigned or transferred except upon written consent of the Village Administrator.
3. All materials used shall conform to such specifications as may be required by the Village Administrator.
4. The work site shall be promptly cleaned upon completion of the required work and all surplus excavated material and debris removed, leaving the site in a neat and orderly condition. Where top soil and/or seeded areas are disturbed, the ground surfaces shall be restored as required by the Village Administrator.
5. Suitable barricades must be maintained while excavation or other work is in progress, as may be required by the Village Administrator. All work must be performed in such a manner as to cause a minimum of inconvenience to traffic.
6. No back filling shall be done until the work authorized by this permit is first inspected by the Village Administrator or his authorized representative.
7. Back filling shall be completed by thoroughly tamping in such a manner as to obtain compacted back fill.
8. Immediately after back filling the excavation, an acceptable temporary resurfacing of the disturbed area shall be completed, as determined by the Village Administrator.
9. Permanent restoration of the surface of a street opening excavation shall be completed as required by the Village Administrator.
10. No permit shall be issued until the applicant has filed with the Village, evidence of suitable liability insurance, workmen's compensation, and property damage insurance, and has presented a deposit in the amount required by the Village. A Public Service corporation may, in lieu of a deposit, file with the Village of Pelham, a surety bond in an amount as determined by the Village Administrator, for the faithful performance of all permits issued to such a corporation

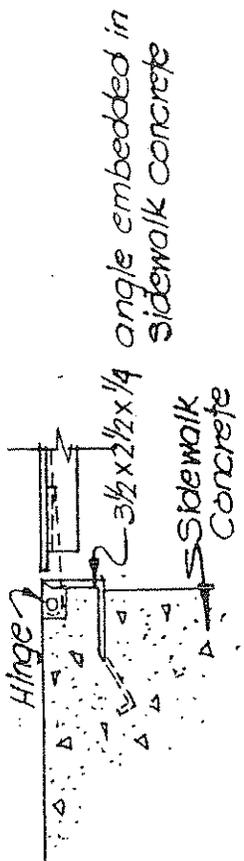


Section 1

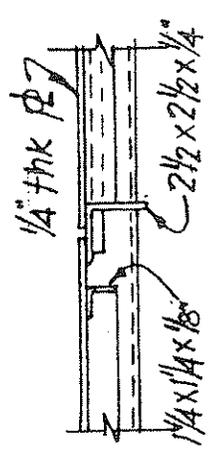


Section 2

Scale: 1/2" = 1'-0"

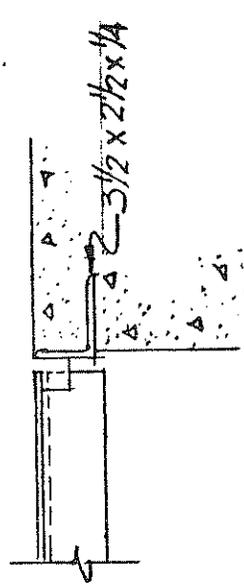


Section 3

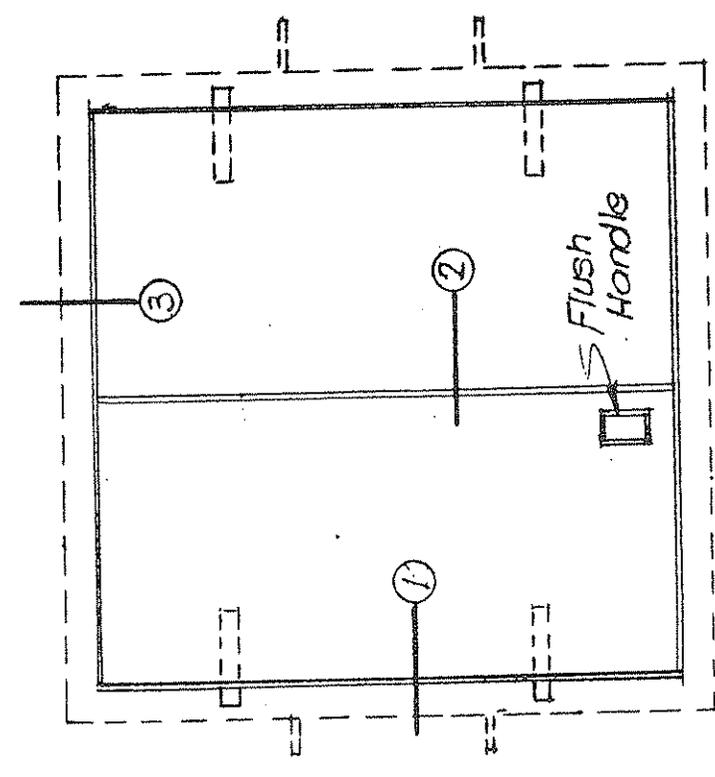

Plan of Sidewalk Door

SIDEWALK HATCHWAY
VILLAGE of PELHAM


Village of Pelham

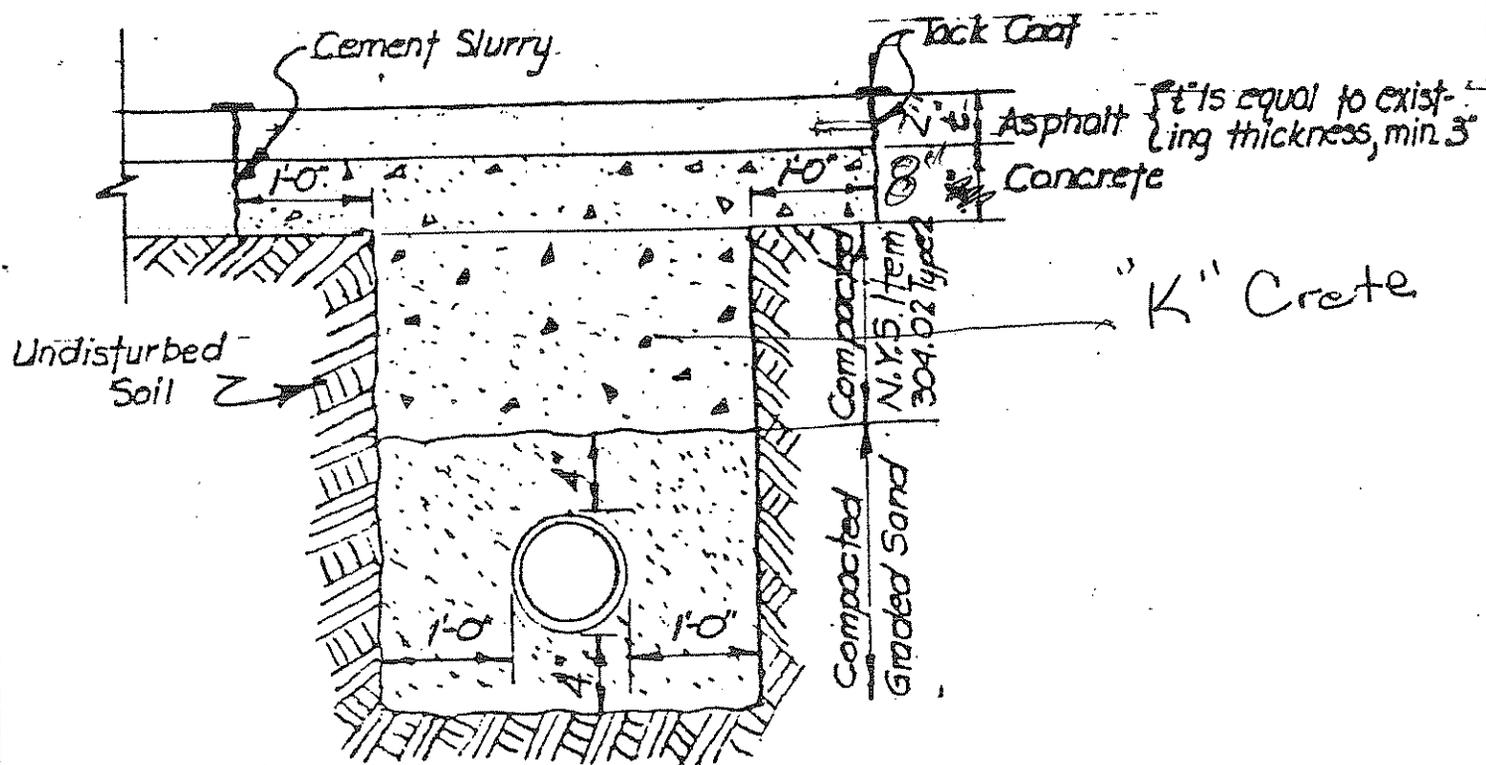

Standard Detail for Excavation & Backfilling for Utility Lines

Note:


1. Trenches over 4'-0" deep shall have sheathing.
2. At least 4" of Graded Sand shall be placed below and above pipe.
3. N.Y.S. Item 304.02 Type 2, shall be placed from top of graded sand to underside of 4" concrete slab.
4. All material shall be compacted to insure no settlement will take place. Mechanical means of compaction shall be used. Layers, not exceeding 12" shall be placed and compacted.
5. A cement slurry shall be applied to the existing concrete prior to placing new concrete, f'c = 3000 psi. min.
6. Tack Coat shall be applied to existing asphalt at least 30 minutes prior to placing the new asphalt wearing surface.
7. New asphalt shall be NYS Type 6 or equal compacted to produce a tight surface conforming to the adjacent pavement area.
 a Tack coat material shall be placed on all of the new patch seam.

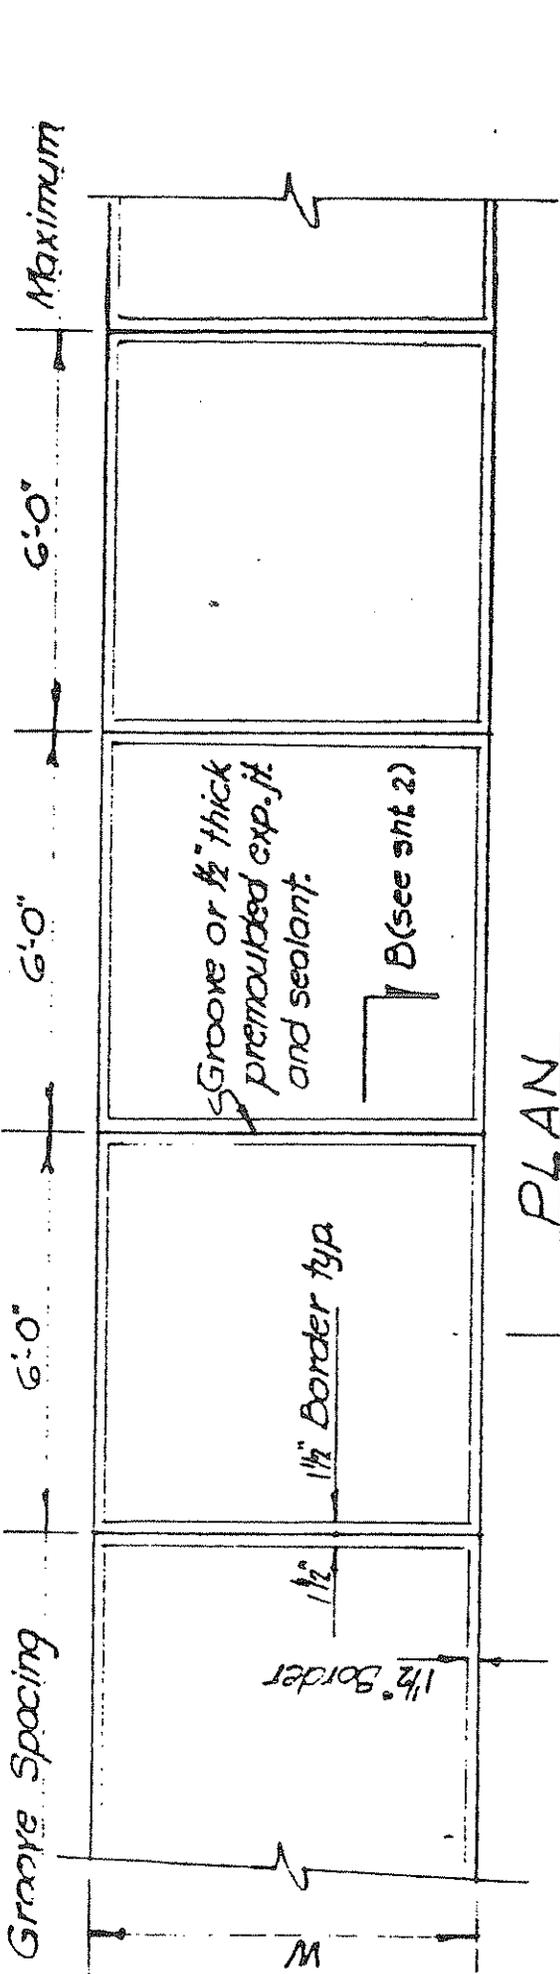


PLAN

Sidewalk Type	W
Main Sidewalk	5'-0" min.
Secondary S/W	4'-0" min.

4" thk concrete sl.
6" Porous Fill
Compacted Sub-base

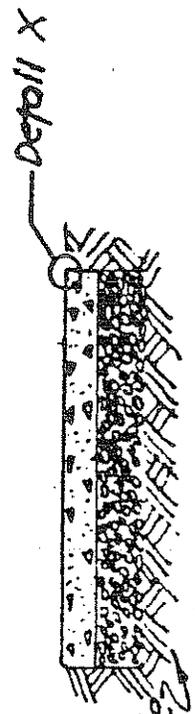

Section A (Typical S/W Section)

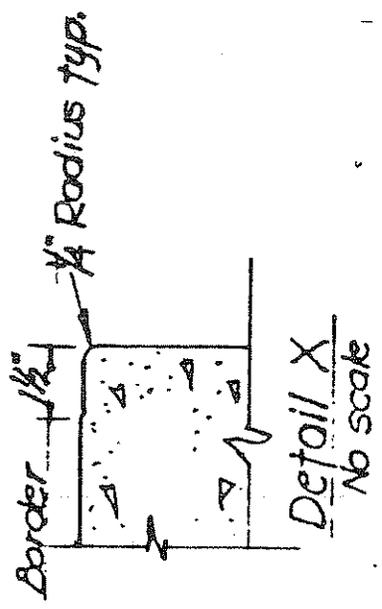

NOTES:

1. Expansion Joint shall be every 20'-0"
2. Sidewalks, where "W" is greater than 15'-0", shall have an intermediate exp. jt. parallel to curb. Submit proposed layout for approval.
3. Thickness of sidewalk slab shall be 4" min.
4. Concrete shall be f'c = 3000 psl. stone.
5. Surface finish of concrete shall be Float.
6. Grooves shall be 3/4" deep.
7. Spacing of grooves to be the same as adjacent sidewalk. 6'-0" is a max. space only.
8. Provide Exp. jt. where S/W abuts vertical surfaces.

SIDEWALK STANDARD
VILLAGE OF PELHAM